

[Data Sheet 7](#)


[See SRL report C/06/5L/3541/1 for full details](#)

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

Client: [Comfortex Ltd](#)  
 Test Date: 04/08/2006  
 Empty Room: Temperature: 21.1 °C Humidity: 67 %RH Pressure: 1003 mbar  
 Room with Sample: Temperature: 21.1 °C Humidity: 67 %RH Pressure: 1003 mbar  
 Sample: [AFP100](#)  
 Description:  
 Sample Area: 11.56 m<sup>2</sup>  
 Cavity Depth: 0 mm  
 Chamber Volume: 300 m<sup>3</sup>

Test 11				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	4.16	3.85	0.08	
63*	4.04	3.68	0.10	n/a
80*	5.39	4.57	0.14	
100	8.56	6.37	0.17	
125	7.33	5.79	0.15	0.20
160	6.88	5.06	0.22	
200	7.23	4.70	0.31	
250	7.77	4.10	0.48	0.45
315	7.34	3.68	0.57	
400	6.41	3.03	0.73	
500	5.52	2.65	0.82	0.80
630	5.07	2.45	0.88	
800	5.36	2.42	0.95	
1000	5.75	2.41	1.01	1.00
1250	5.64	2.38	1.01	
1600	5.21	2.20	1.10	
2000	4.80	2.05	1.17	1.00
2500	4.22	2.00	1.10	
3150	3.58	1.86	1.08	
4000	3.05	1.66	1.15	1.00
5000	2.45	1.49	1.10	
6300*	1.87	1.21	1.22	
8000*	1.37	1.01	1.09	n/a
10000*	0.99	0.79	1.07	
$\alpha_w$ 0.75(MH)				
Class C				
Calculated to EN ISO 11654:1997				
NRC 0.85				
Calculated to ASTM C 423-01				
* Denotes frequencies outside the range covered by BS EN ISO 354:2003				
T1, empty room reverberation time				
T2, room reverberation time with sample				

Sound Absorption Coefficient

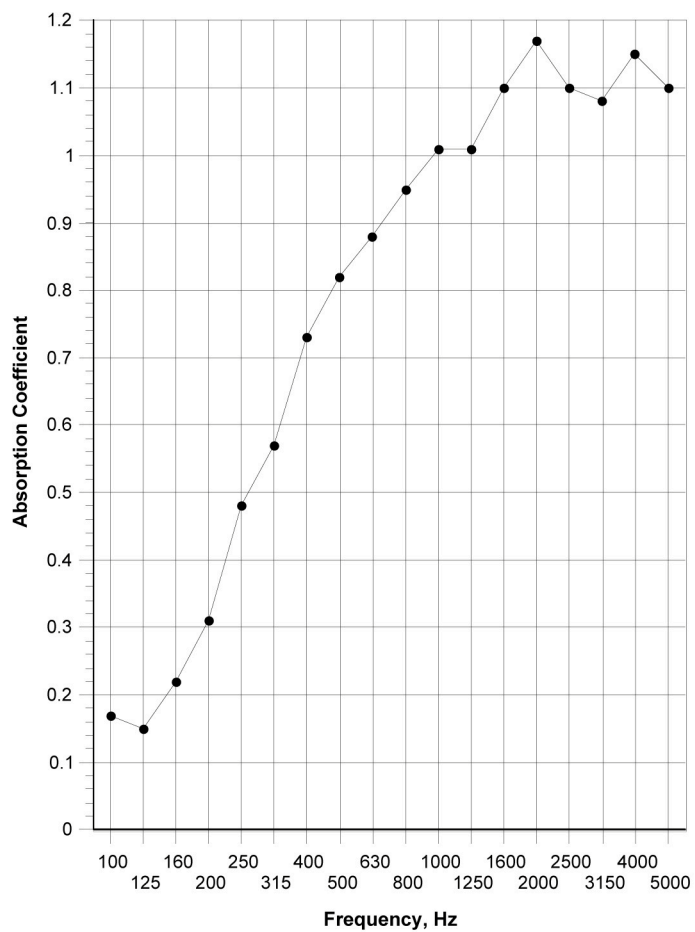

# Practical absorption coefficient, BS EN ISO 11654:1997

v1